

# IES Indoor Report

Photometric Filename:UL-1006-0300-CH-(1)-帶面蓋-3000K.IES



## Indoor Luminaire Photometric Data

### Description Information

Luminaire Name:		Lum. Catalog:	Test ID:
Lamp Name:		Lamp Catalog:	Test Date: 2024/03/28
Manufacture:		Shld. Ang(°):	Test Machine:GON-2000
Test Lab:		Frequency (Hz):	Lamp CCT(K): 3000 Ra:
Lum. Size(W*L*H):0.050m*-0.050m*0.000m		Lum. Area(m2):0.002	Lum. W(kg): 0.000
Test System: C, γ	Test Step: C=1.0 γ=30.0	Temp.(°C): 25	Humidity(%): 50.0

### Character Parameter

Lamp Speciality Parameter		Luminaire Speciality Parameter	
Rated Flux(lm): 54.890	Luminaire Flux(lm): 54.893	Field Angle(10%Imax): 70.5(°)	
Rated Power(W): 3	Luminaire Efficiency: 100.01%	Down Lumens&Percent: 31.139lm 56.73%	
Rated Voltage(V): 220	Luminaire EER(lm/W): 19.173	Up Lumens&Percent: 23.754lm 43.27%	
Tested Power(W): 2.863	Max. Candela(cd): 54.983	S/MH: C0_a180=-1.#10 C90_270=-1.#10	
Lamps' Inside: 1	Max Cand@Ang.(°): C=43.0 γ=90.0	CIE Type: Semi-Indirect	
Tested Electrics(V, A, pf):229.9, 0.026, 0.474	Beam Angle(50%Imax): 33.1(°)	ErP Φ use(90°): 1.034lm	
Lamp Size(W*L*H):0.050m*-0.050m*0.000m	Left=72.1°, Right=105.2°	IRF(%): 136.501	

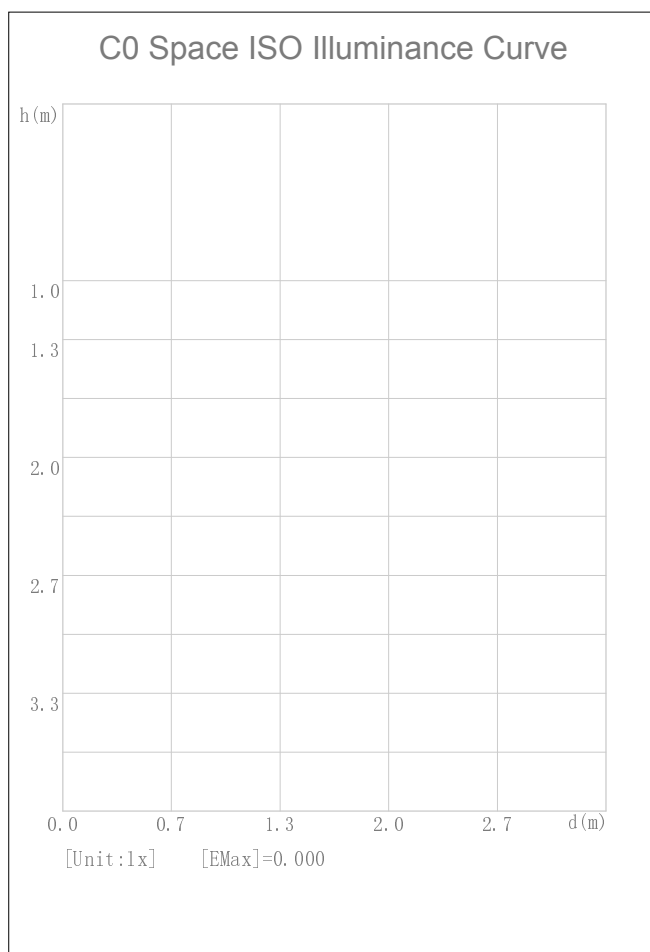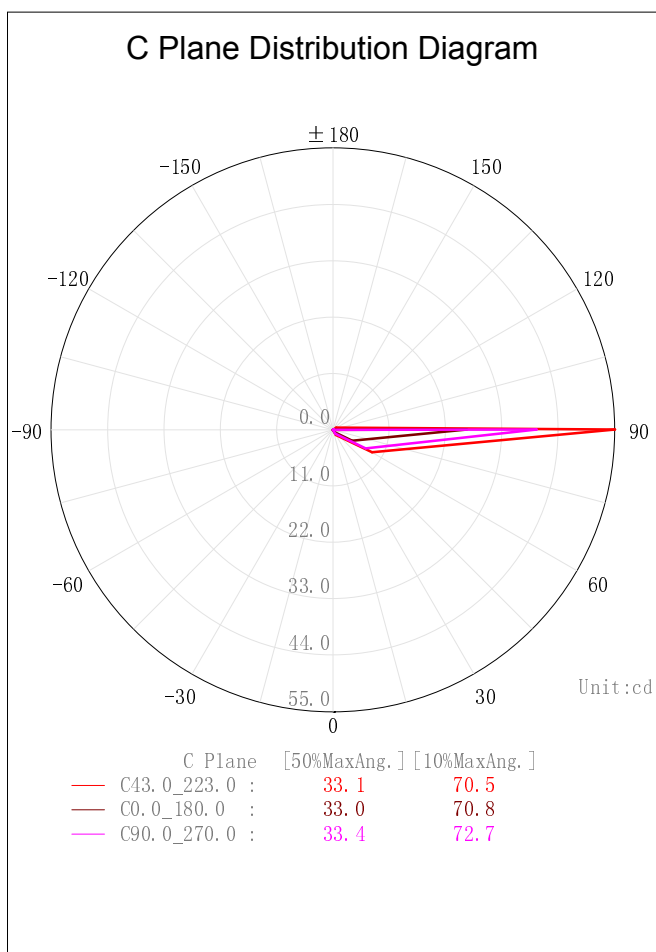



# IES Indoor Report

Photometric Filename:UL-1006-0300-CH-(1)-帶面蓋-3000K.IES

## 2D Plane Light Intensity Distribution Curve

Lum. Name :	Lum. Catalog :	Test ID :
Lamp Name :	Lamp Catalog :	Test Lab :
Manufacture :	Test Machine:GON-2000	Test Date: 2024/03/28

C Plane Distribution Diagram

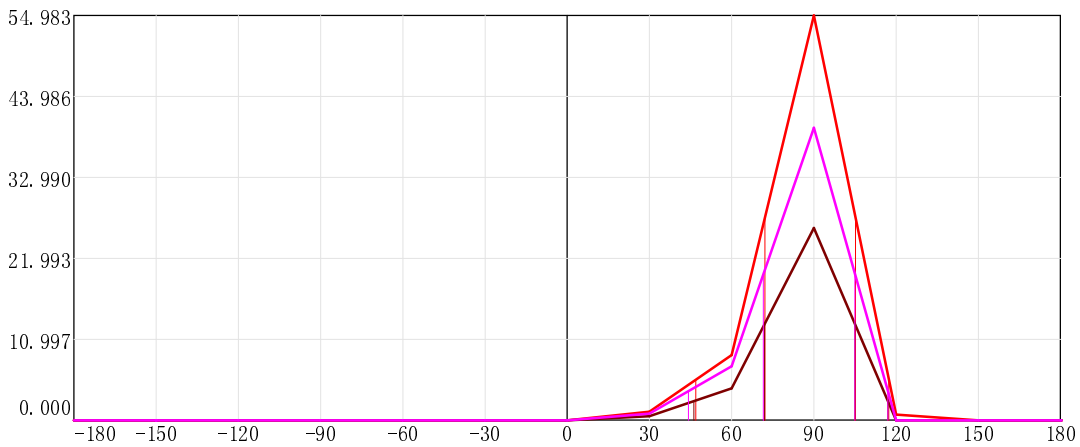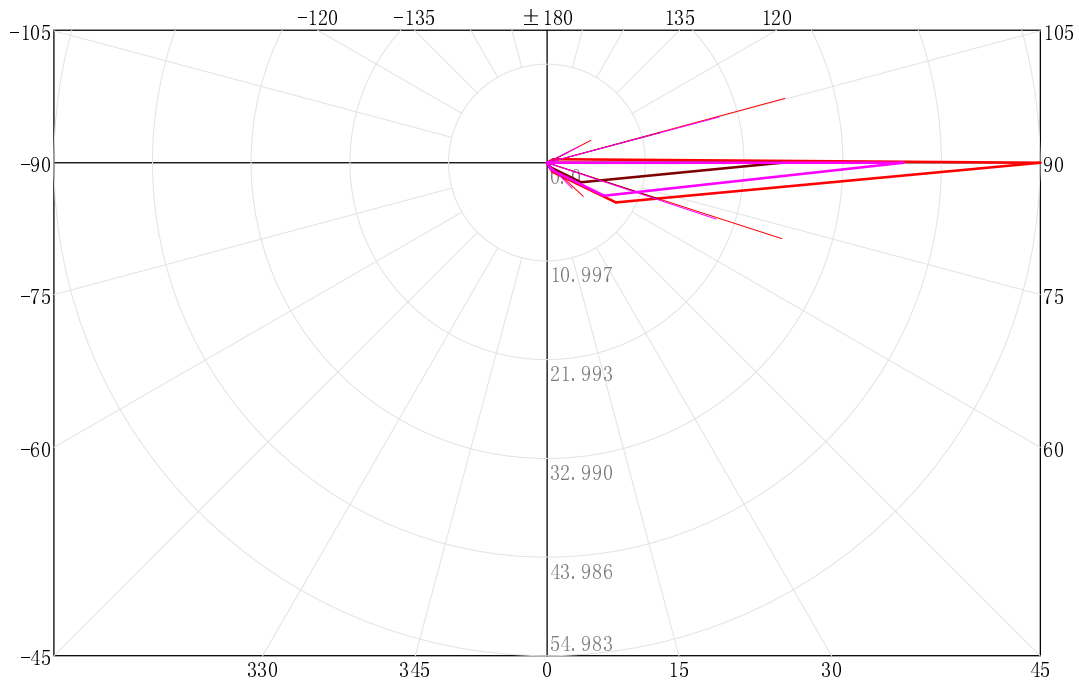

	C Plane	[50%MaxAng. ]	[10%MaxAng. ]	Unit:cd
—	C43_0_223_0 :	33.1	70.5	
—	C0_0_180_0 :	33.0	70.8	
—	C90_0_270_0 :	33.4	72.7	

# IES Indoor Report


Photometric Filename:UL-1006-0300-CH-(1)-帶面蓋-3000K.IES

---

## 3D Light Intensity Distribution Modal

Lum. Name:	Lum. Catalog:	Test ID:
Lamp Name:	Lamp Catalog:	Test Lab:
Manufacture:	Test Machine:GON-2000	Test Date: 2024/03/28

### 3D Light Intensity Distribution Modal

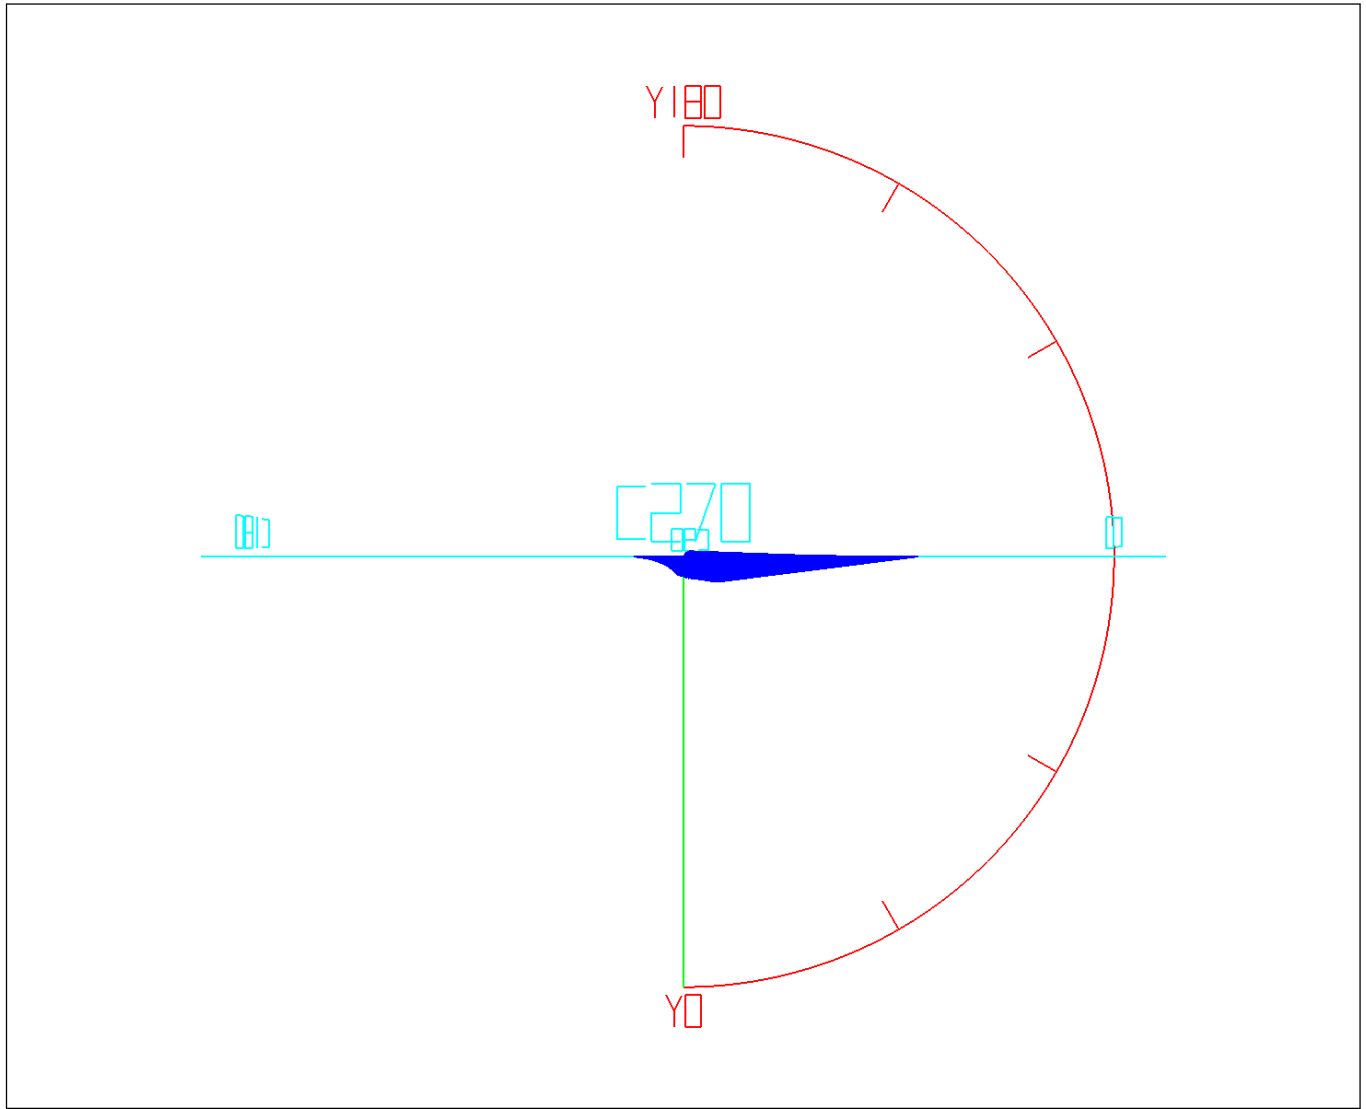

Curves: 3D Model ——— Fixture ——— Vert. HUD ——— Hori. HUD ———  
View Angles: Orient:0 Tilt:0 Roll:0 Spin:0

---

# IES Indoor Report

Photometric Filename:UL-1006-0300-CH-(1)-帶面蓋-3000K.IES

---

## Zonal Flux Tabulation


Zone( $\gamma$ )	Zone Flux (lm)	Sums Flux (lm)	Zone%Lamp	Sums%Lamp
0. 0-30. 0	0. 14	0. 14	0. 25	0. 25
30. 0-60. 0	3. 39	3. 53	6. 17	6. 42
60. 0-90. 0	27. 61	31. 14	50. 31	56. 73
90. 0-120. 0	23. 65	54. 78	43. 08	99. 81
120. 0-150. 0	0. 11	54. 89	0. 20	100. 01
150. 0-180. 0	0. 00	54. 89	0. 00	100. 01

# IES Indoor Report

Photometric Filename:UL-1006-0300-CH-(1)-帶面蓋-3000K.IES

## Rectangle ISO Lighting Intensity Diagram

Lum. Name:	Lum. Catalog:	Test ID:
Lamp Name:	Lamp Catalog:	Test Lab:
Manufacture:	Test Machine:GON-2000	Test Date: 2024/03/28

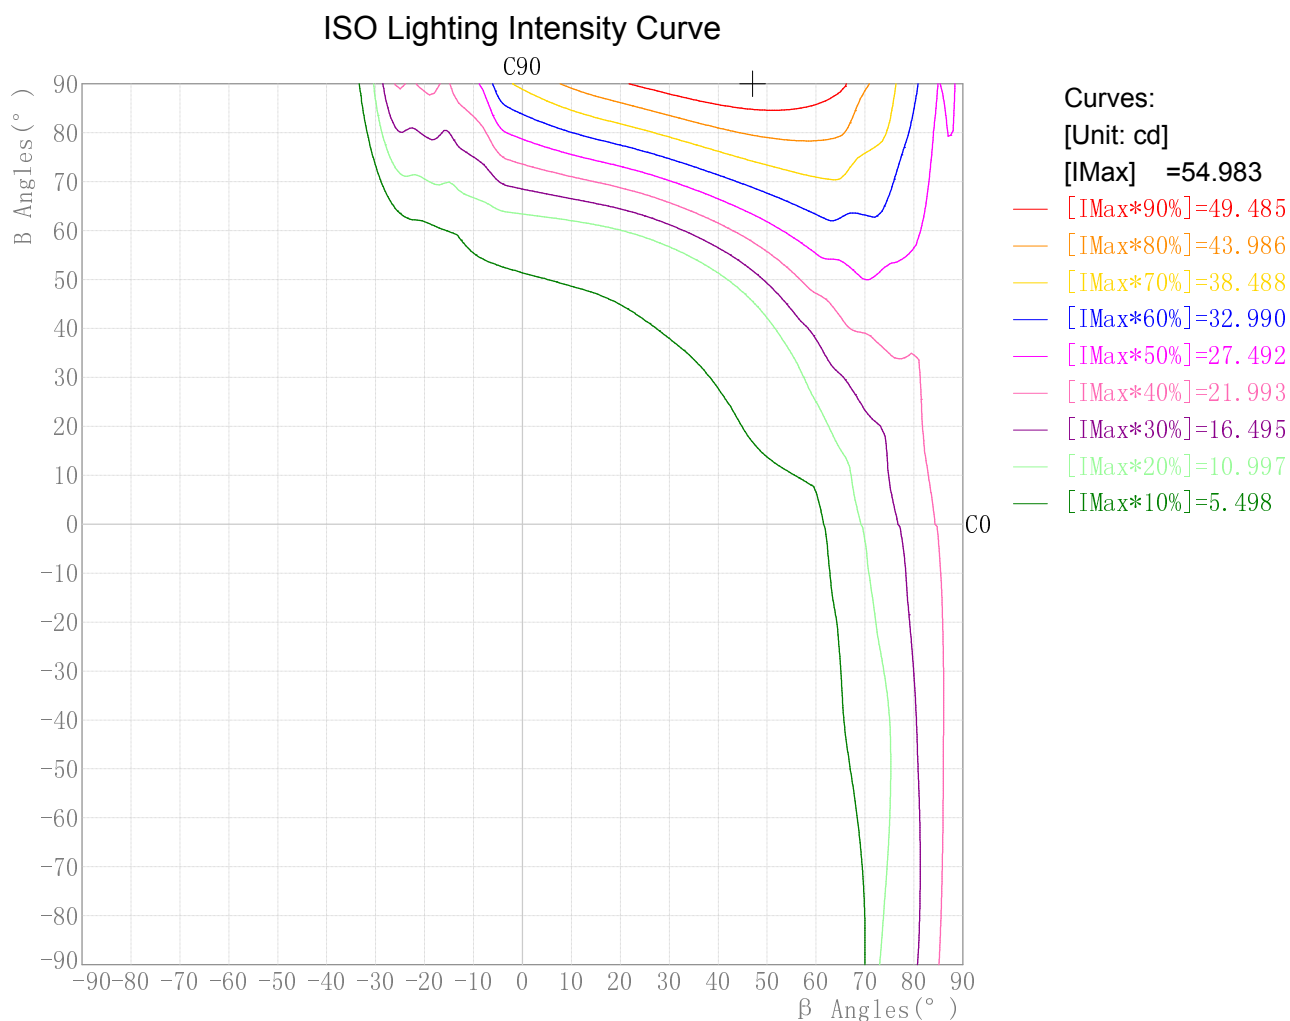


Maximum Light Intensity(cd): 54.98  
Maximum Cand.@Angle: H=47.0°,V=90.0°

**IES Indoor Report**

**Photometric Filename:UL-1006-0300-CH-(1)-帶面蓋-3000K.IES**

**Plane ISO-Illuminance Diagram**

Lum. Name:	Lum. Catalog:	Test ID:
Lamp Name:	Lamp Catalog:	Test Lab:
Manufacture:	Test Machine:GON-2000	Test Date: 2024/03/28

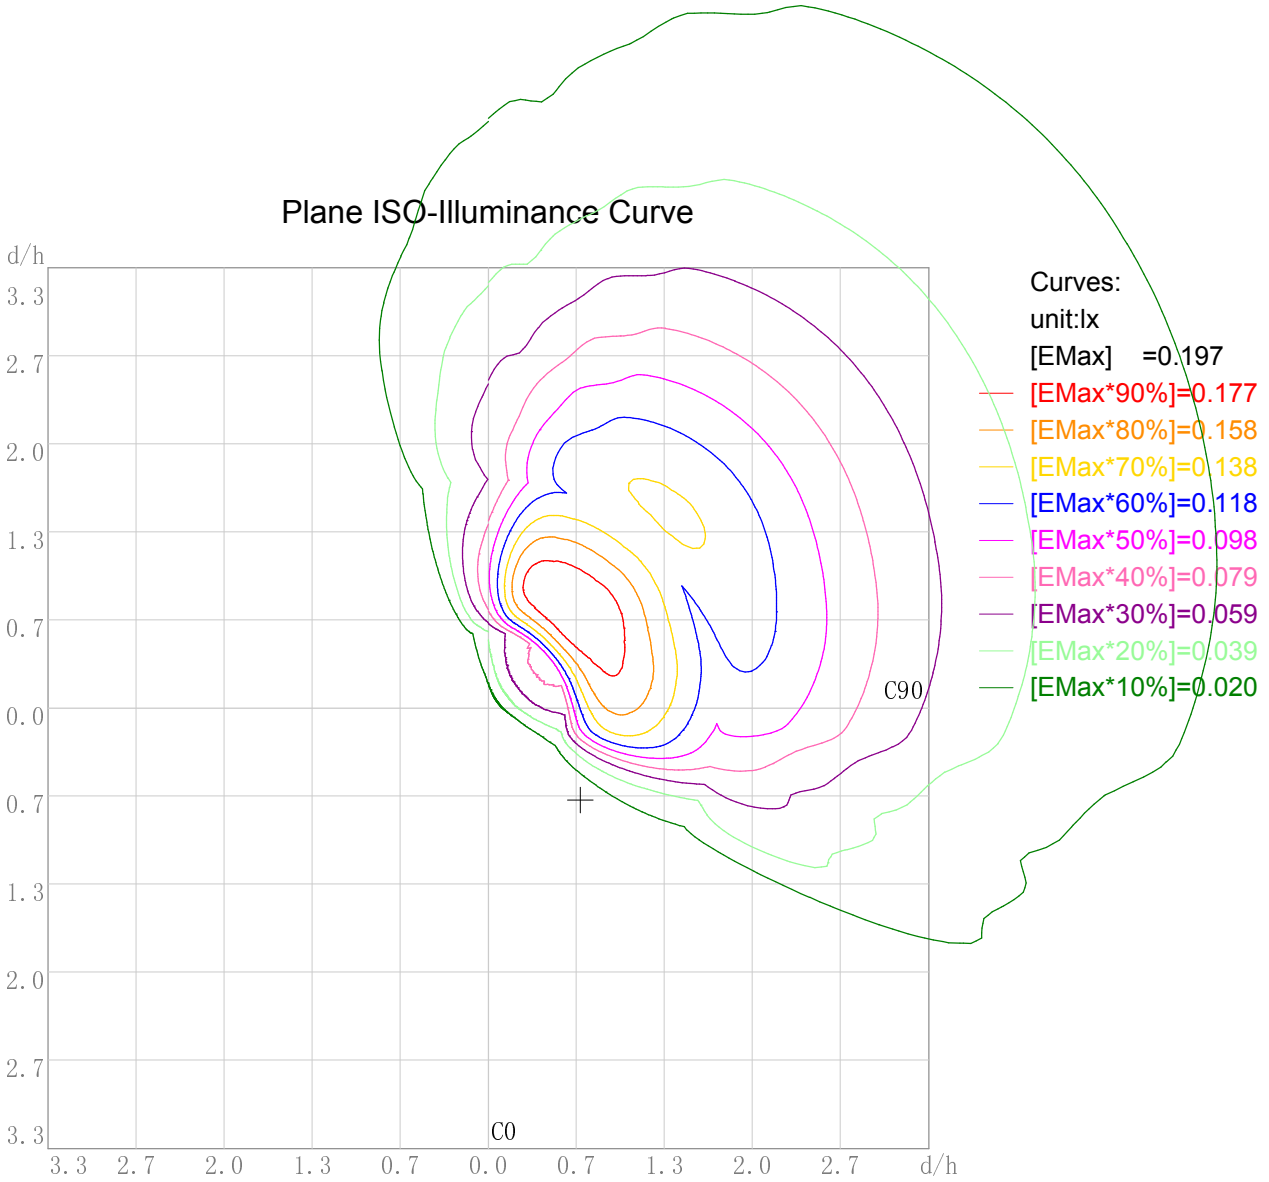

Working Plane Luminaire Mounting Height(m): 3.00  
Working Plane Maximum Illuminance(lx): 0.20  
Working Plane Maximum Illuminance Position(d/h):H0.7 V0.7


# IES Indoor Report

Photometric Filename:UL-1006-0300-CH-(1)-帶面蓋-3000K.IES

## 3D Plane ISO Illuminance Diagram

Lum. Name:	Lum. Catalog:	Test ID:
Lamp Name:	Lamp Catalog:	Test Lab:
Manufacture:	Test Machine:GON-2000	Test Date: 2024/03/28

### 3D Plane Illuminance Modal

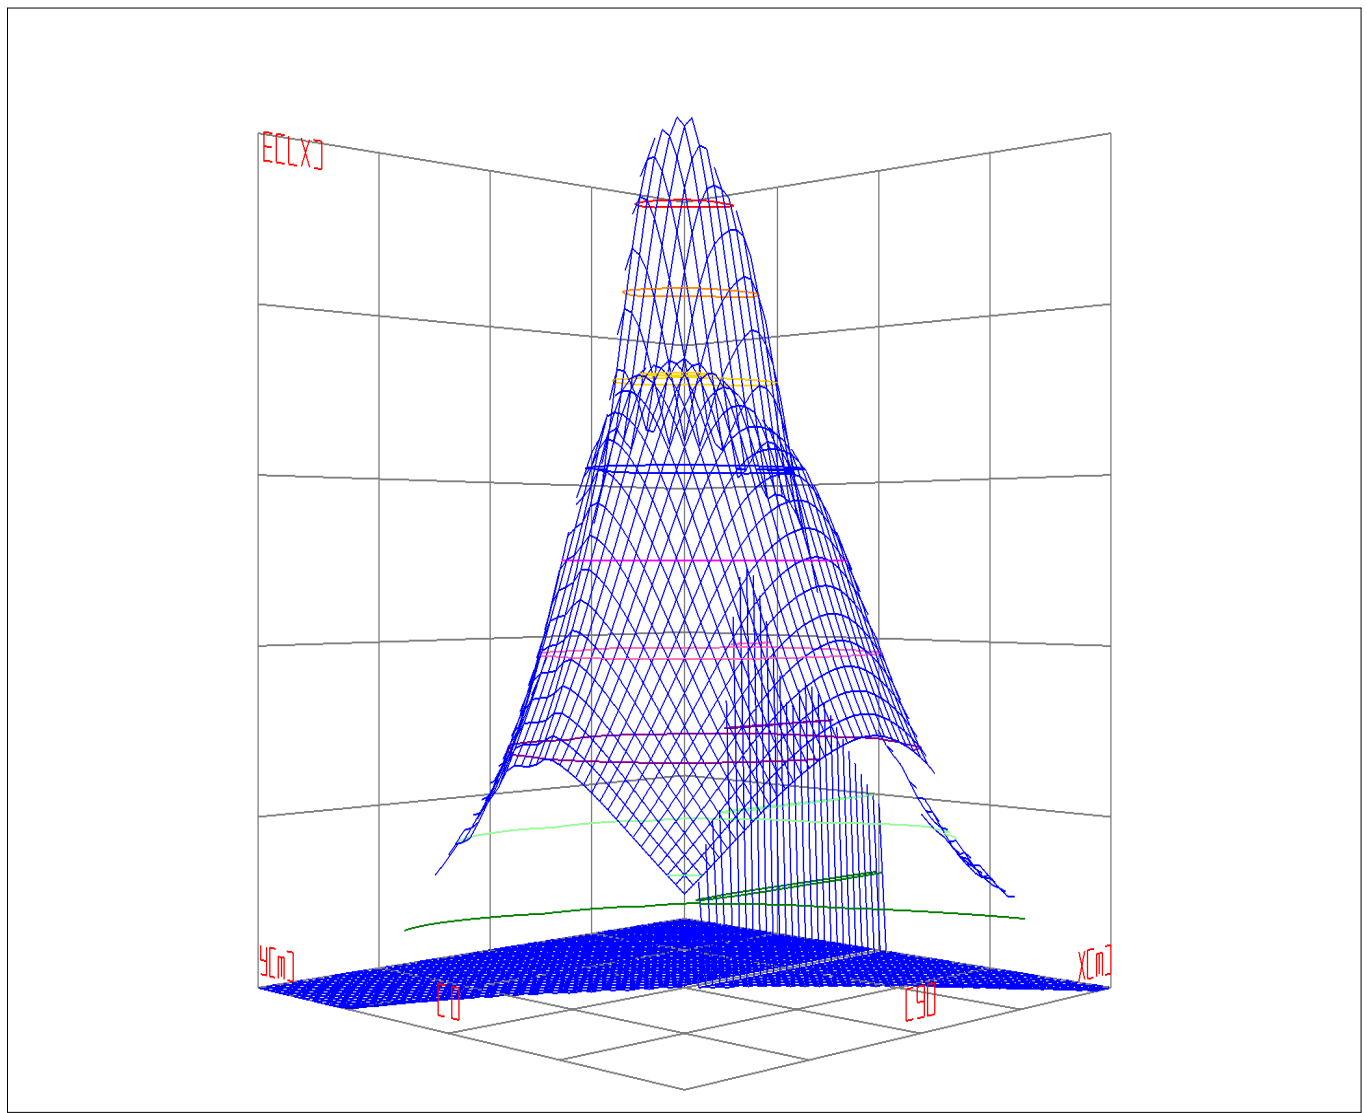

Curves: 3D Model — 90% — 80% — 70% — 60% — 50% — 40% — 30% — 20% — 10% —  
View Angles(deg): 0 Height(m): 3.0 Distance(m): 10.0

# IES Indoor Report


Photometric Filename:UL-1006-0300-CH-(1)-帶面蓋-3000K.IES

---

## Space ISO Illuminance Diagram

Lum. Name:	Lum. Catalog:	Test ID:
Lamp Name:	Lamp Catalog:	Test Lab:
Manufacture:	Test Machine:GON-2000	Test Date: 2024/03/28

### Space ISO Illuminance Curve

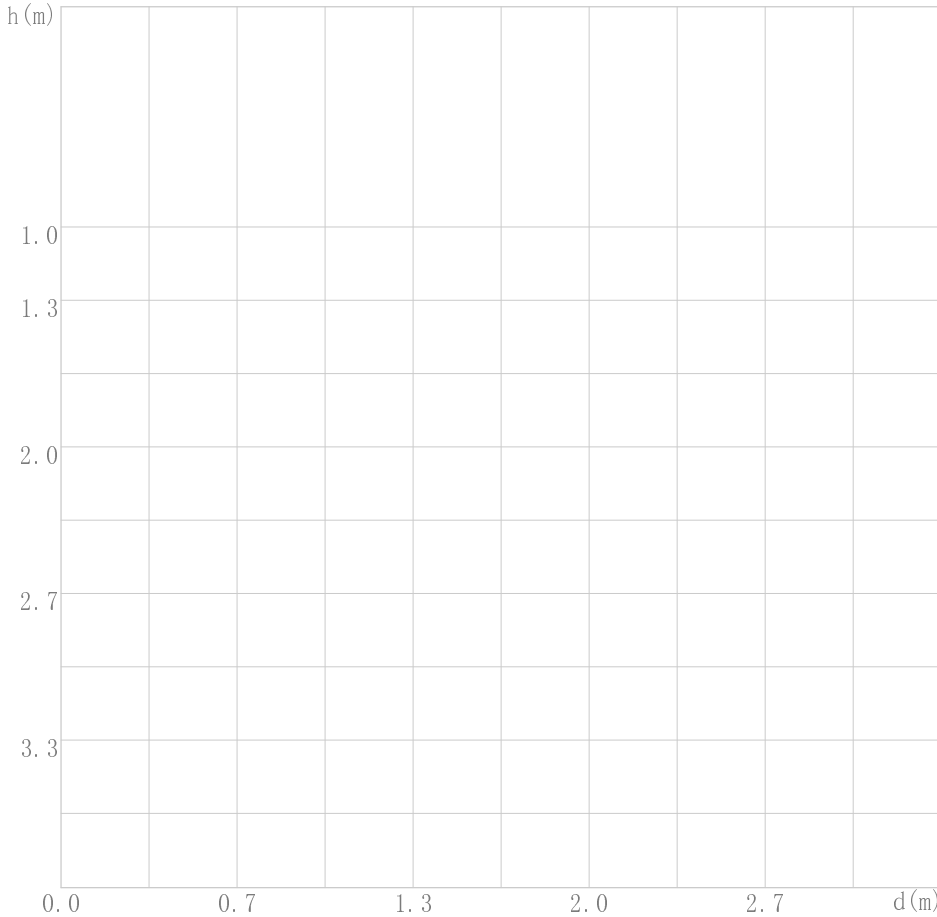

Curves:  
[Unit: lx]  
[EMax] =0.000

Space Plane Maximum Illuminance and @Angle:0.00lx,0.0deg  
Plane Maximum Lighting Intensity and @Angle:0.000cd,0deg

---




# IES Indoor Report

Photometric Filename:UL-1006-0300-CH-(1)-帶面蓋-3000K.IES

## Illuminance-Distance Diagram

Lum. Name:	Lum. Catalog:	Test ID:
Lamp Name:	Lamp Catalog:	Test Lab:
Manufacture:	Test Machine:GON-2000	Test Date: 2024/03/28

Illuminance-Distance Curve

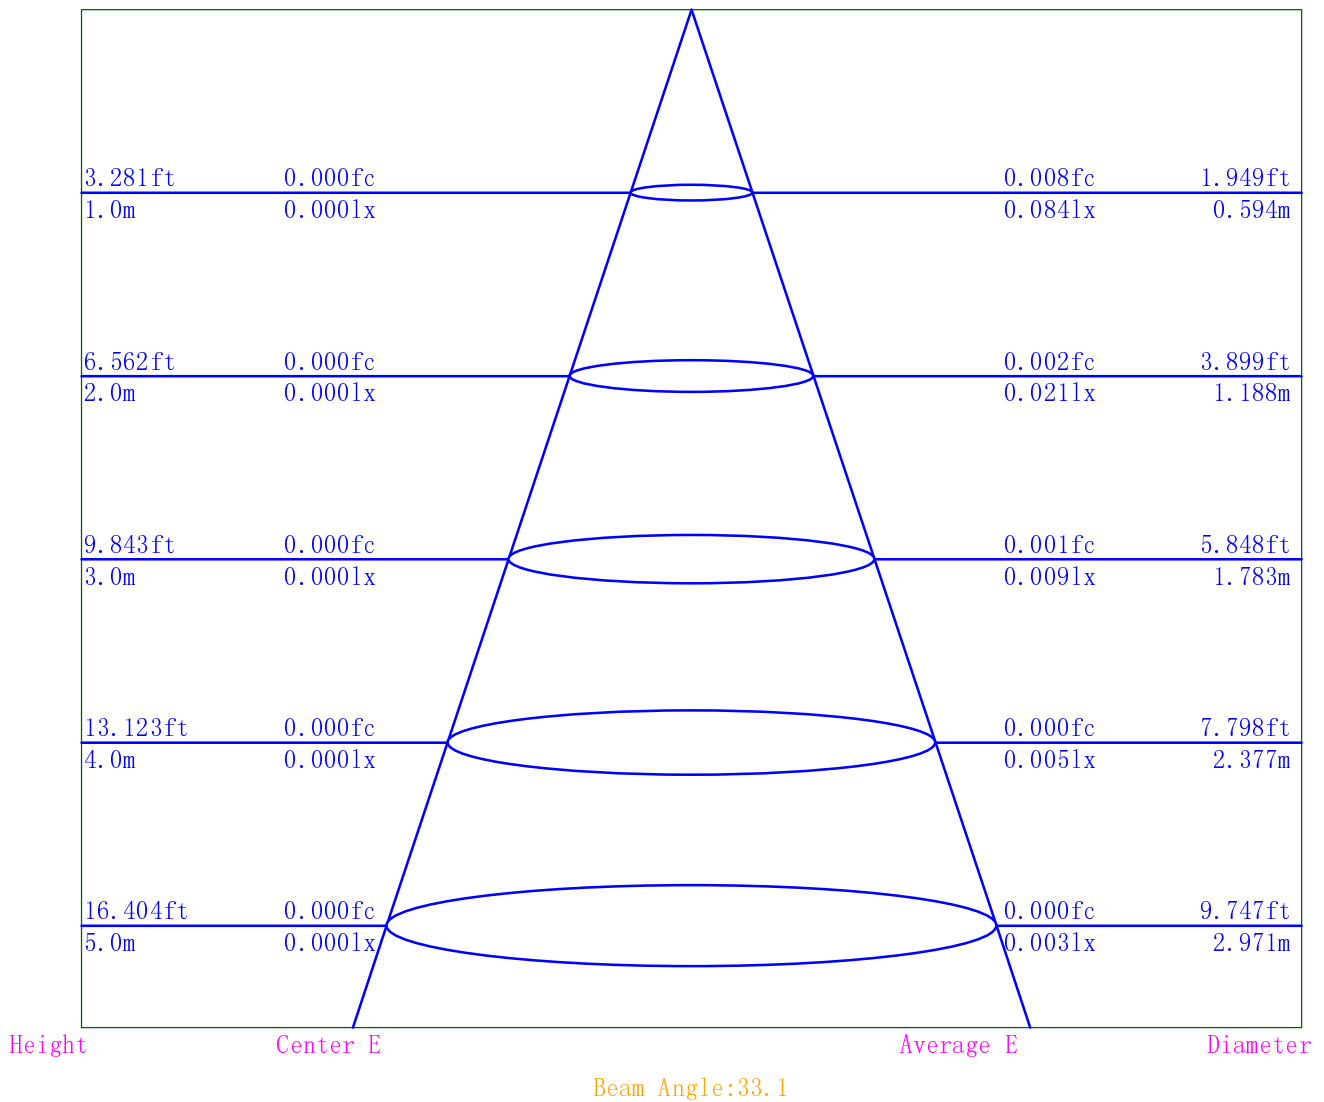

# IES Indoor Report

Photometric Filename:UL-1006-0300-CH-(1)-帶面蓋-3000K.IES

## Indoor Luminance Limiting Curves

Lum. Name:	Lum. Catalog:	Test ID:
Lamp Name:	Lamp Catalog:	Test Lab:
Manufacture:	Test Machine:GON-2000	Test Date: 2024/03/28


Glare Grade Table

GI	Quality	Using Illuminance							
		a	b	c	d	e	f	g	h
1.15	A	2000	1000	500	<=300				
1.5	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.2	D				2000	1000	500	<=300	
2.55	E	a				2000	1000	500	<=300
			b	c	d	e	f	g	h

Luminance Table

Gama (deg)	45	50	55	60	65	70	75	80	85
C0	1770	2450	3309	4442	9622	17285	29971	55298	131349
C90	2974	4122	5574	7489	15362	27017	46320	84865	200615

Luminance Limiting Curve

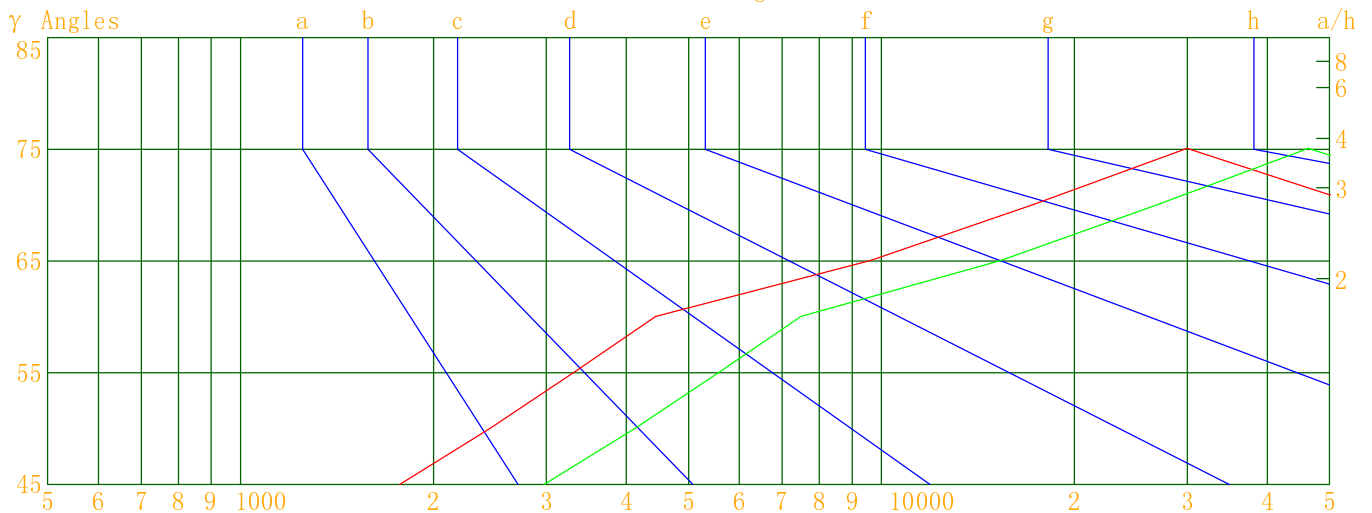


Luminous Size: Length(m)=-0.050 Width(m)=-0.050 Height(m)=0.000 Area(m^2)=0.001963  
 Luminous Type: Without Luminous Side  
 Luminous Curves: C0-C180 Color: — C90-C270 Color: —

# IES Indoor Report

Photometric Filename:UL-1006-0300-CH-(1)-帶面蓋-3000K.IES

## Indoor Budgetary Estimate Table

Lum. Name:	Lum. Catalog:	Test ID:
Lamp Name:	Lamp Catalog:	Test Lab:
Manufacture:	Test Machine:GON-2000	Test Date: 2024/03/28

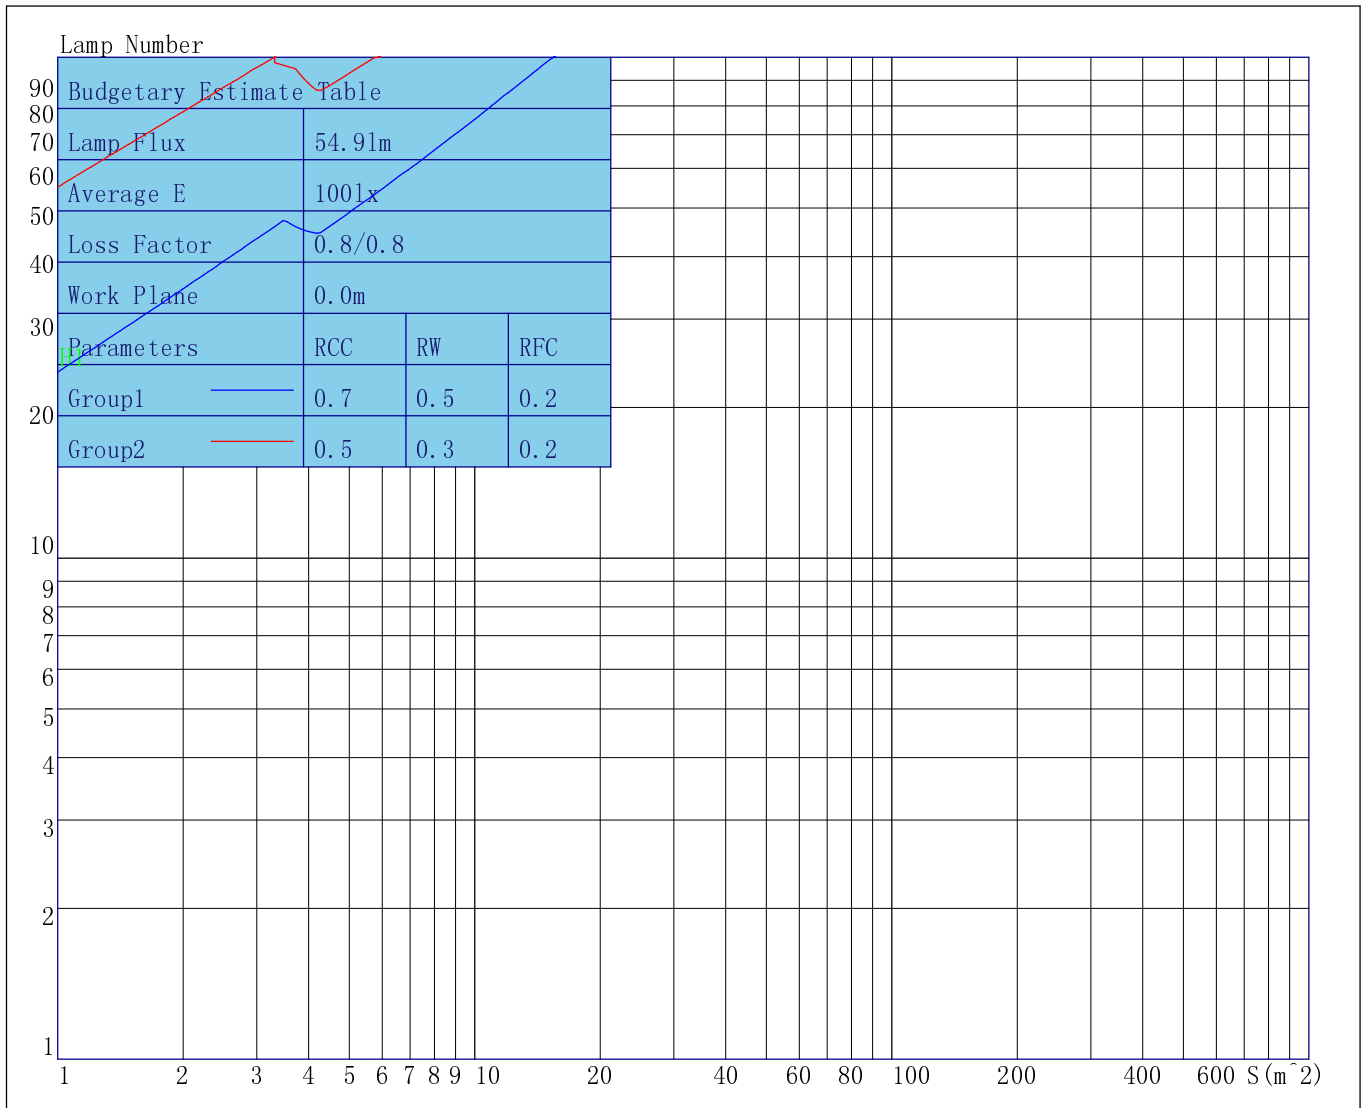

Parameters1: Rhocc = 0.7 Rhow = 0.5 Rhofc = 0.2 LLF = 0.8  
 Parameters2: Rhocc = 0.5 Rhow = 0.3 Rhofc = 0.2 LLF = 0.8  
 Average Illuminance(lx): 100 Cavity Height: H1(m) = 2

# IES Indoor Report

Photometric Filename:UL-1006-0300-CH-(1)-帶面蓋-3000K.IES

## Indoor Coefficient of Utilization Table

Lum. Name:	Lum. Catalog:	Test ID:
Lamp Name:	Lamp Catalog:	Test Lab:
Manufacture:	Test Machine:GON-2000	Test Date: 2024/03/28

Coefficients of Utilization - Zonal Cavity Method																		
Coef.	Effective Floor Cavity Reflectance RFC=0.20																	
RhoCC (%)	80				70				50			30			10			0
RhoW (%)	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR	Coefficient of Utilization(%)																	
0	110	110	110	110	103	103	103	103	90	90	90	78	78	78	68	68	68	62
1	88	78	69	62	81	72	64	57	60	54	48	50	45	40	40	36	32	27
2	76	63	52	42	69	57	47	39	47	39	32	38	31	26	29	24	19	14
3	68	52	41	31	61	48	37	29	39	30	23	31	24	18	23	18	13	8
4	61	45	33	25	55	41	30	22	33	25	18	26	19	14	20	14	9	5
5	55	39	28	20	50	36	26	18	29	21	14	23	16	11	18	12	7	4
6	51	35	24	17	46	32	22	15	26	18	12	21	14	9	16	10	6	3
7	47	31	21	14	43	29	19	13	24	16	10	19	12	7	14	9	5	2
8	44	28	19	12	40	26	17	11	21	14	9	17	11	6	13	8	4	1
9	41	26	17	11	37	24	15	10	20	12	8	16	10	6	12	7	4	1
10	38	24	15	9	35	22	14	8	18	11	7	15	9	5	11	7	3	1

# IES Indoor Report

Photometric Filename:UL-1006-0300-CH-(1)-帶面蓋-3000K.IES

## Unified Glare Rating Table

Lum. Name:	Lum. Catalog:	Test ID:
Lamp Name:	Lamp Catalog:	Test Lab:
Manufacture:	Test Machine:GON-2000	Test Date: 2024/03/28

## Unified Glare Rating Table

Ceiling RCC	0.70	0.70	0.50	0.50	0.30	0.70	0.70	0.50	0.50	0.30
Wall RW	0.50	0.30	0.50	0.30	0.30	0.50	0.30	0.50	0.30	0.30
Floor RFC	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20
Room Size	Vewed crosswise					Vewed endwise				
X=2H Y=2H	15.7	16.9	16.5	17.8	18.9	16.8	18.0	17.7	18.9	20.1
Y=3H	22.4	23.6	23.3	24.5	25.7	24.3	25.5	25.2	26.4	27.5
Y=4H	25.8	26.9	26.6	27.8	29.0	28.0	29.1	28.9	30.0	31.2
Y=6H	29.2	30.2	30.0	31.1	32.3	31.8	32.8	32.6	33.7	34.9
Y=8H	31.0	32.0	31.8	32.9	34.1	33.7	34.7	34.6	35.7	36.9
Y=12H	33.0	34.0	33.9	34.9	36.1	35.8	36.8	36.7	37.8	39.0
X=4H Y=2H	19.0	20.1	19.8	21.0	22.2	19.4	20.5	20.3	21.4	22.6
Y=3H	25.2	26.2	26.1	27.2	28.4	26.2	27.2	27.1	28.1	29.3
Y=4H	28.4	29.4	29.3	30.3	31.6	29.8	30.8	30.7	31.7	32.9
Y=6H	31.7	32.6	32.6	33.5	34.7	33.5	34.4	34.4	35.4	36.6
Y=8H	33.4	34.2	34.3	35.2	36.4	35.5	36.3	36.4	37.3	38.5
Y=12H	35.3	36.1	36.2	37.0	38.3	37.7	38.5	38.6	39.4	40.7
X=8H Y=4H	30.3	31.2	31.2	32.1	33.4	31.1	32.0	32.0	33.0	34.2
Y=6H	33.8	34.6	34.7	35.6	37.0	34.9	35.7	35.9	36.7	38.1
Y=8H	35.7	36.4	36.6	37.3	38.6	37.0	37.8	37.9	38.7	40.0
Y=12H	37.6	38.3	38.5	39.2	40.5	39.3	40.0	40.3	41.0	42.2
X=12H Y=4H	30.9	31.7	31.8	32.7	33.9	31.6	32.4	32.5	33.4	34.6
Y=6H	34.6	35.3	35.5	36.3	37.5	35.5	36.2	36.4	37.2	38.4
Y=8H	36.6	37.2	37.5	38.2	39.5	37.7	38.3	38.6	39.3	40.6
Variations with the objerver position at spacings										
S=1.0H	0.2/-0.3					0.3/-0.4				
S=1.5H	0.6/-0.7					0.5/-0.7				
S=2.0H	0.7/-0.9					0.7/-0.9				
Reduced UGR Table:										
Nordic Standard Table:	BKO					BKO				
Correction Value	12.0					12.1				

o the CIE Pub.117, data has been corrected, refers to the lamp's lumens 8.2flm.











