


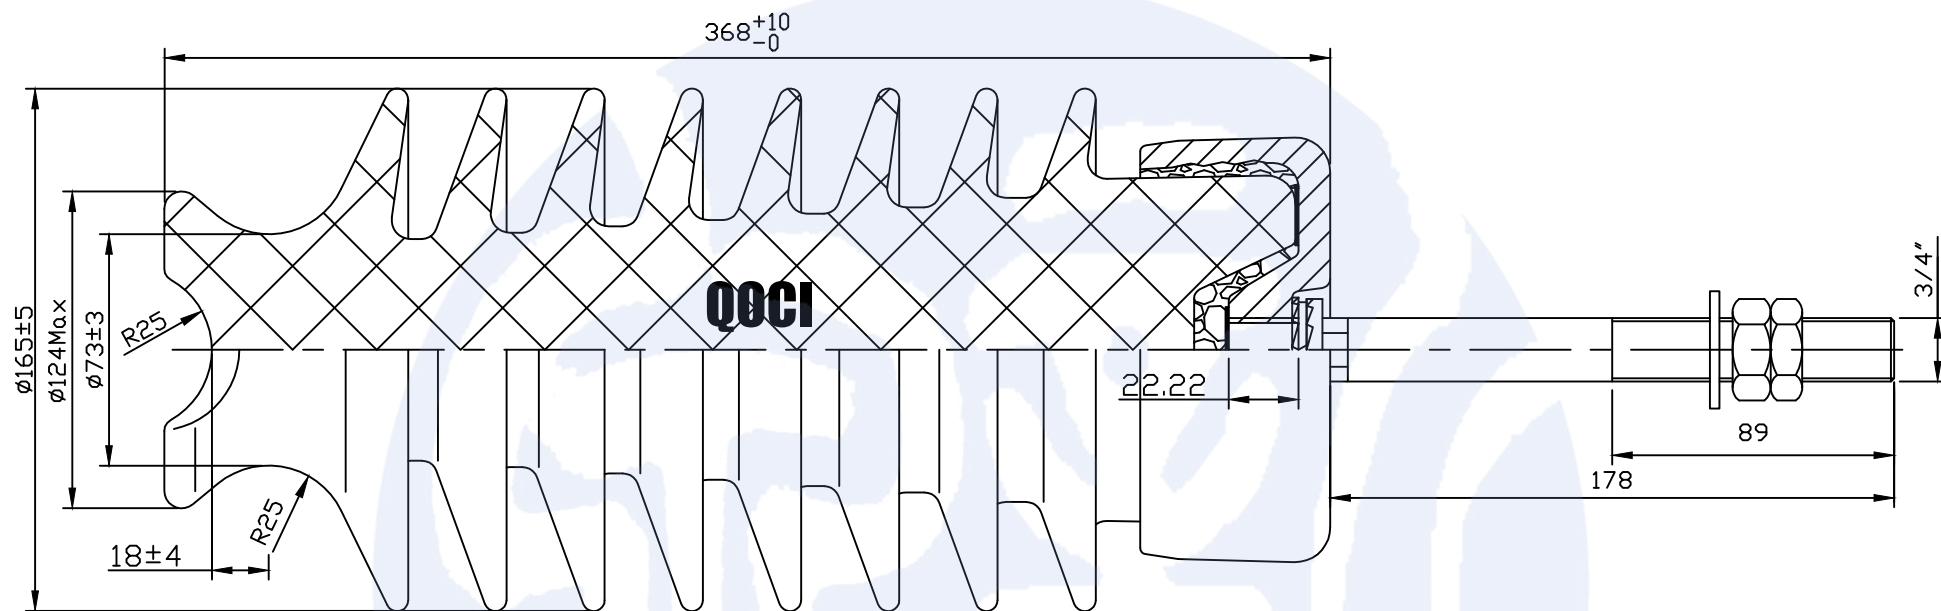

TECHNICAL DATA

Type

Standard Applied

Main Dimensions D:

H:

Leakage Distance

Dry Arcing Distance

Cantilever Strength

Low Frequency Wet Flashover Voltage

Low Frequency Dry Flashover Voltage

Critical Impulse Flashover Voltage (Pos.)

(Neg.)

Radio-Influence Voltage

Test Voltage to Ground

Maximum RIV, at 1000kHz

ANSI 57-3

ANSI C29.7

165mm

368mm

737mm

311mm

12.5kN

100kV


125kV

210kV

260kV

30kV

200 μ V

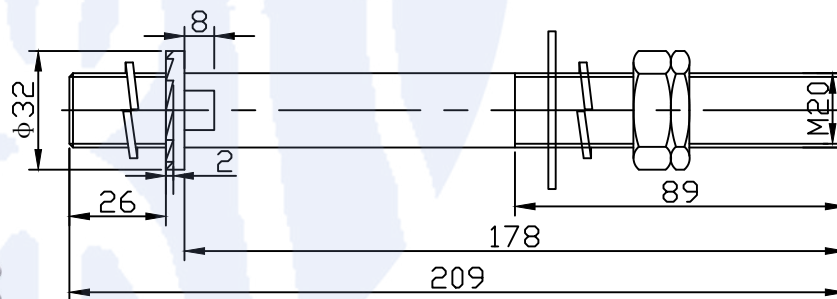

Jiangxi QOCI Electric CO.,LTD.

Click to visit the official website

Design	Standard	Marker
Num	Sigh	
Audit	Date	Weight
Notes	Approved	Scale 1:1



QOCI

Post Type
Porcelain Insulator

ANSI 57-3